


**SEC. A-A**

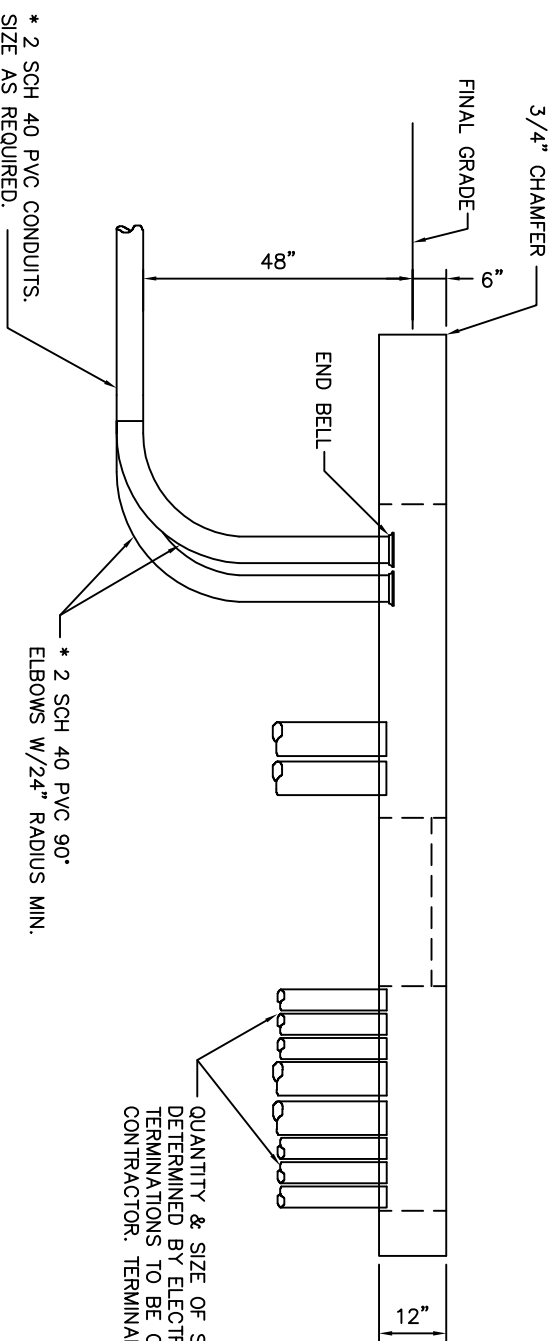

QUANTITY & SIZE OF SERVICE CONDUITS TO BE DETERMINED BY ELECTRICAL CONTRACTOR. TERMINATIONS TO BE COMPLETED BY ELECTRICAL CONTRACTOR. TERMINALS FURNISHED BY CONTRACTOR.

**TRANSFORMER - SECONDARY ENCLOSURE PAD DETAIL FOR SERVICES WITH 8 SETS OF CONDUCTORS OR GREATER**

\* NOTE: FOR 35 KV USE 6" CONDUIT, 4" CONDUIT FOR 15 KV PRIMARY. COMPACTED SUB GRADE BENEATH PAD.