


② NOTES:

1. ALL CONCRETE TO BE 3600 PSI STRENGTH.
2. ALL CONSTRUCTION PRACTICES, INCLUDING COMPACTION, CURING, FINISHING, AND ETC. SHALL BE IN ACCORDANCE WITH THE CITY OF MONROE STANDARD SPECIFICATIONS AND DETAIL MANUAL.
3. IN AREAS WITH EXISTING 4" SIDEWALK, REMOVE SIDEWALK WITHIN DRIVE AREA AND REPLACE WITH 6" MINIMUM THICK CONCRETE AT DRIVEWAY ENTRANCE
4. CURING COMPOUND MEMBRANE IS REQUIRED ON ALL CONCRETE CONSTRUCTION. ①

② BACK OF SIDEWALK ELEVATION ABOVE STREET CROWN

R/W	W/TREES	W/O TREES
50'	4-7/8"	3-5/8"
60'	6-3/8"	5-1/8"

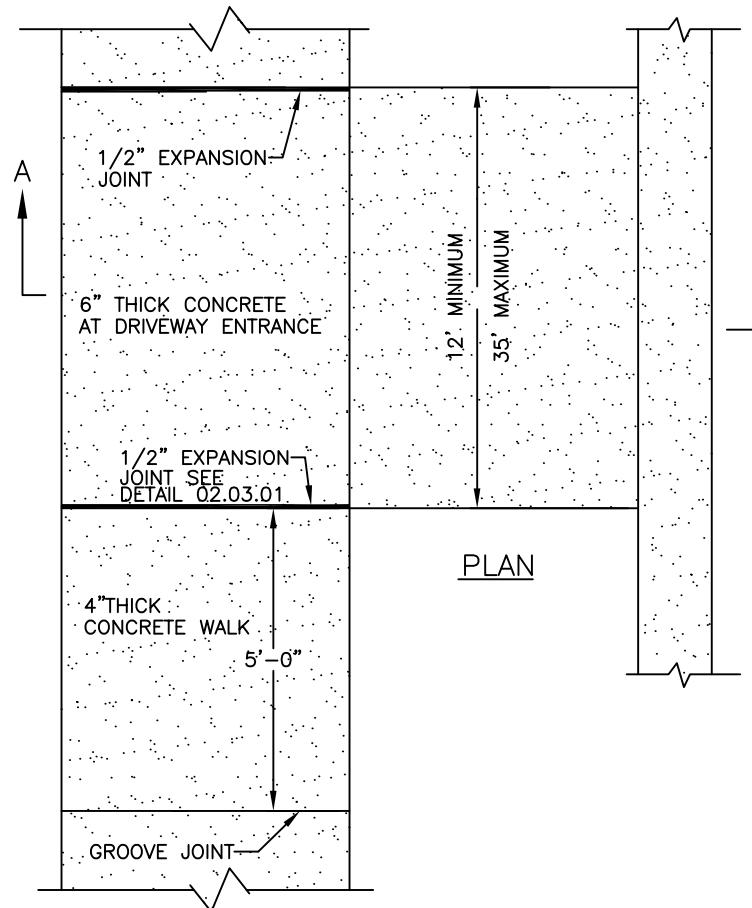

REVISIONS		
NO.	DATE	DESCRIPTION
1	05/08	ADD NOTE
2	01/15	REMOVE NOTE #1 ADD TABLE REVISE DIMS ON SECTION A-A



RESIDENTIAL DRIVEWAY
FOR VALLEY GUTTER

CITY OF MONROE
UNION COUNTY NORTH CAROLINA
PREPARED BY:
ENGINEERING DEPARTMENT

FILE: I:/Maps-Details/Detail Manual/Details
DRAWN BY: JAM DATE: 08-07-01
CHECKED BY: JNL SCALE: N.T.S.
DETAIL 02.04.03