


SIDEWALK WIDTH	"Y"
5' - 0"	1 1\2"
6' - 0"	1"
7' - 0"	1\2"
8' - 0" +	0"

SECTION B-B

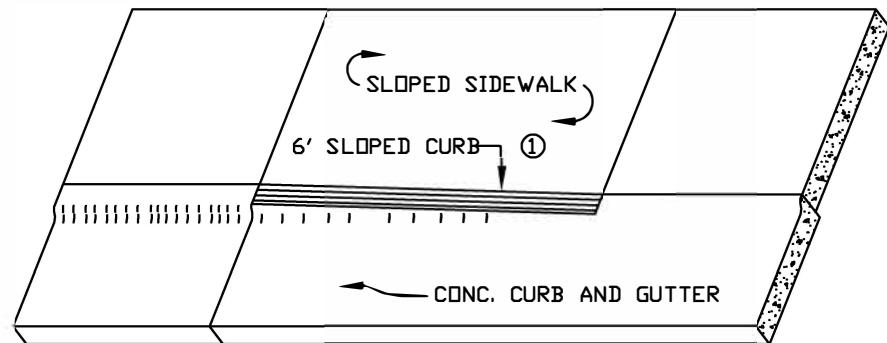

ISOMETRIC VIEW

NOTE:

ALL CONCRETE TO BE 3600 PSI, SUBGRADE TO BE COMPAKTED TO 100% STANDARD PROCTOR DENSITY. CITY ENGINEERING DEPARTMENT MUST INSPECT SUBGRADE AND FORMS PRIOR TO PLACEMENT OF CONCRETE.

REVISIONS		CONCRETE DRIVEWAY DROP CURB TYPE (2 of 2)	CITY OF MONROE UNION COUNTY NORTH CAROLINA PREPARED BY: ENGINEERING DEPARTMENT	FILE: I:/Maps-Details/Detail Manual/Details
NO.	DATE			DRAWN BY: JAM DATE: 08-07-01
1	01/15	SIDEWALK MIN FROM 4' TO 5' ADD 6' WIDTH TO SLOPED CURB		CHECKED BY: JNL SCALE: N.T.S.
				DETAIL 02.04.02

