




GENERAL NOTES:

1. A STABILIZED PAD OF CRUSHED STONE SHALL BE LOCATED WHERE TRAFFIC WILL BE ENTERING OR LEAVING A CONSTRUCTION SITE TO OR FROM A PUBLIC STREET.
2. STONE TO BE 2 TO 3 INCH WASHED STONE
3. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC STREETS OR EXISTING PAVEMENT. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT.
4. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC STREETS MUST BE REMOVED IMMEDIATELY. WHEN NECESSARY WHEELS MUST BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTERING A PUBLIC STREET. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WHICH DRAINS INTO AN APPROVED SEDIMENT BASIN.
5. FILTER FABRIC SHALL BE MIRAFI 500 OR EQUAL.
6. ENTRANCE SHALL BE A MINIMUM OF 20' IN WIDTH OR THE WIDTH OF THE EXIT, WHICHEVER IS GREATER.

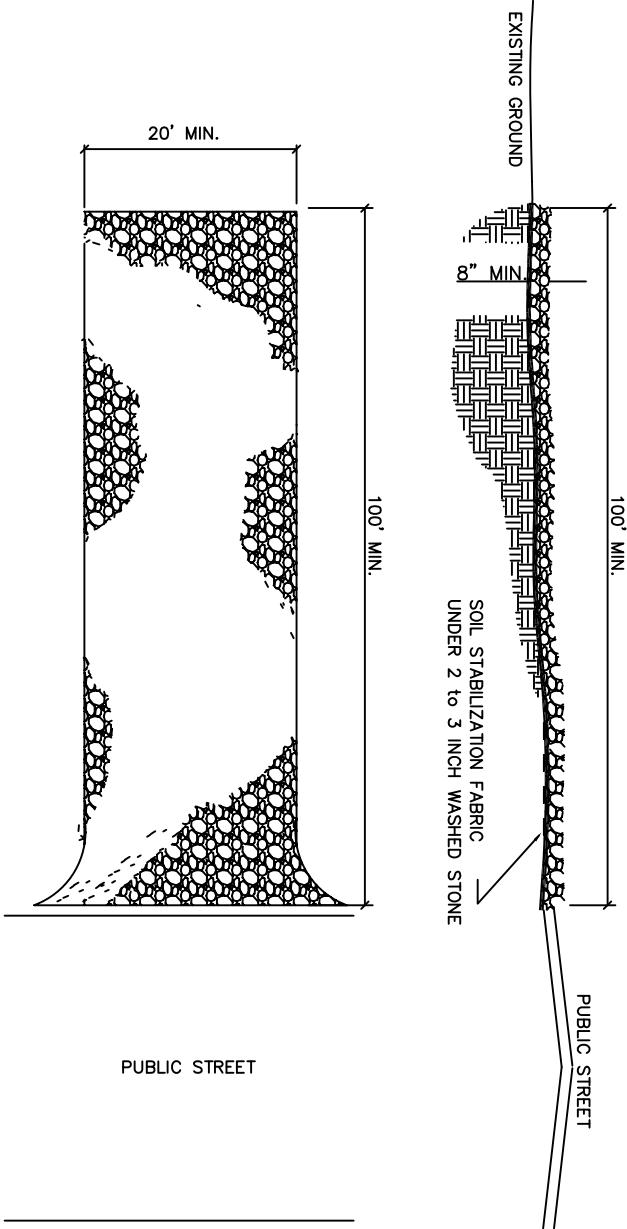

APPROVED DATE

REVISIONS		
NO.	DATE	DESCRIPTION
1	4/20/04	ENTRANCE WIDTH
2	04/11	STONE SIZE



CITY OF MONROE	
CONSTRUCTION	
ENTRANCE	
<i>UNION COUNTY</i>	<i>PREPARED BY:</i>
<i>NORTH CAROLINA</i>	<i>SCALE: N.T.S.</i>
ENGINEERING DEPARTMENT	
DETAIL 03.04.01	

FILE: 1-New_1/Maps-Details/Detail Manual&Specs/
Standard Detail & Spec Manual/Standard details/03