


NOTES:

A MINIMUM OF 6" FROM OUTSIDE DIAMETER OF PIPE TO SIDE OF TRENCH MUST BE ALLOWED FOR WASHED STONE. THE METHOD OF COMPACTING BACKFILL MATERIAL IS SUBJECT TO APPROVAL BY THE ENGINEERING DIRECTOR. MIRAFI 500 FILTER FABRIC OR APPROVED EQUAL SHALL BE PLACED AROUND STONE AND OVERLAPPED 6" AT TOP WITHIN STREET RIGHT OF WAY. PIPE SIZE TO BE SHOWN ON PLAN (MINIMUM 4" PIPE). PIPE TO BE SCHEDULE 20 OR 40 PERFORATED PVC.

SPECIAL NOTE:

PREFABRICATED DRAINAGE MAY BE USED WITH APPROVAL OF ENGINEERING DIRECTOR.

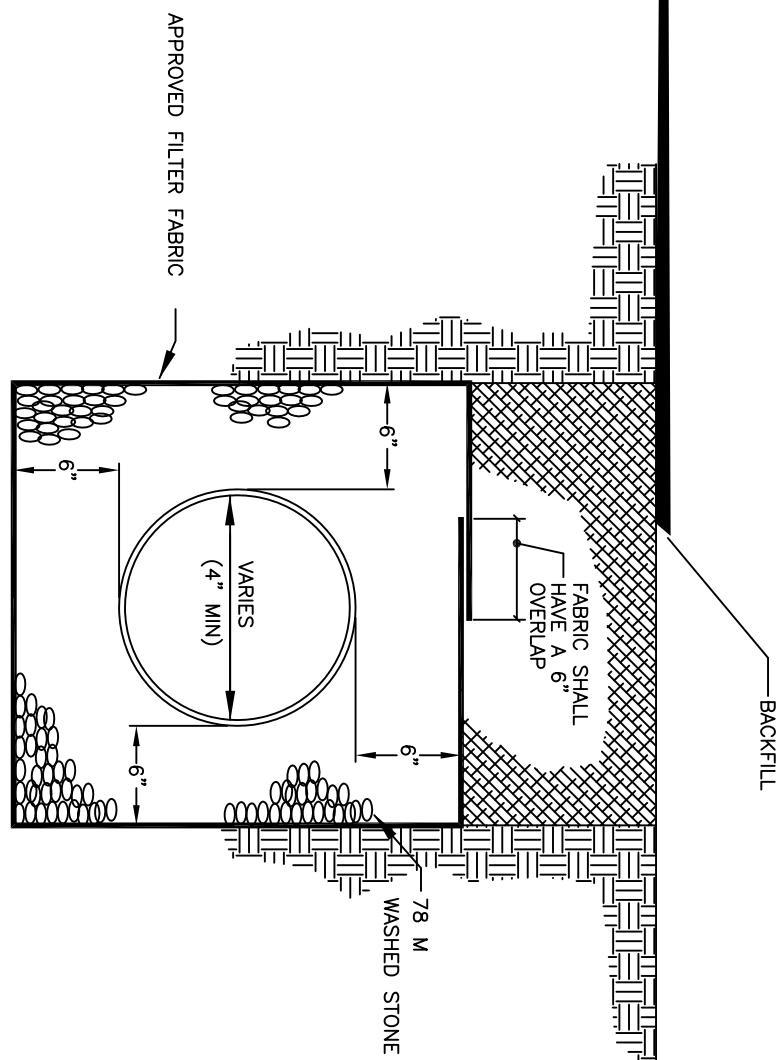

APPROVED DATE _____

NO.	DATE	DESCRIPTION
		
		<i>FRENCH DRAIN DETAIL</i>

CITY OF MONROE UNION COUNTY NORTH CAROLINA	FILE: I:/Maps-Details/Detail Manual/Details DRAWN BY: JAM CHECKED BY: JNL SCALE: N.T.S.	PREPARED BY: ENGINEERING DEPARTMENT DETAIL 04.04.02
--	--	---